


ITEM

- 1 4" FLG x PE CONNECTION PIECE
- 2 4" FLG GATE VALVE W/ HANDWHEEL
- 3 4" x 3" FLG REDUCER
- 4 3" FLG x PE CONNECTION PIECE
- 5 3" FLG COUPLING ADAPTER
- 6 3" FLG METER STRAINER (FURNISHED & INSTALLED BY SDCW)
- 7 3" COMPOUND WATER METER (FURNISHED & INSTALLED BY SDCW)
- 8 4" x 2" SERVICE SADDLE W/ 2" BALL VALVE
- 9 2" TYPE K RIGID COPPER & FITTINGS
- 10 2" PREFABRICATED METER SETTER (PER SDCW DETAIL)
- 11 4' x 8' PREFABRICATED VAULT W/ CONCRETE FOUNDATION (PER SDCW DETAIL)

NOTES

1. CONTRACTOR SHALL USE SOLID CMU BLOCKING AND SHIMS AS PIPE SUPPORT NEAR CENTER OF PIPING RUN
2. CONTRACTOR SHALL LOCATE METER VAULT BEHIND CURB & GUTTER IN AREA THAT IS NOT SUBJECT TO VEHICULAR TRAFFIC.
3. CONTRACTOR SHALL SLOPE GRADE AWAY FROM THE VAULT.

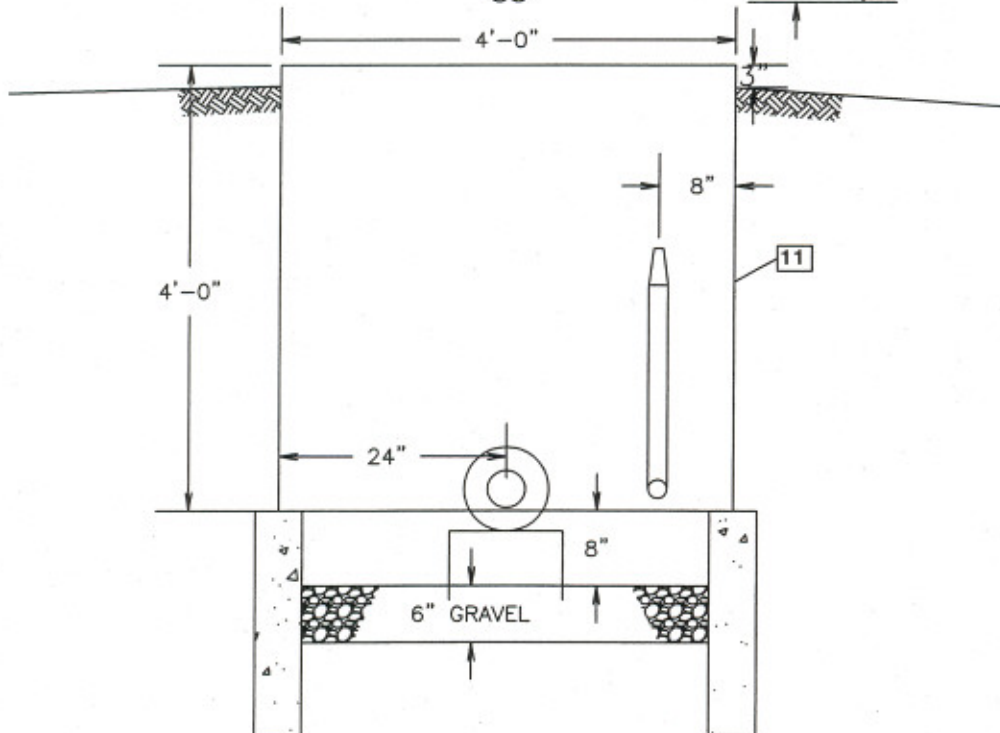


SANGRE DE CRISTO WATER DIVISION
CITY OF SANTA FE, NEW MEXICO
STANDARD DETAILS



3" DOMESTIC SERVICE

DRAWN BY: BKS	DATE: 04/28/04
CHECKED:	SCALE: N/A
APPROVED:	U:/STANDARDS/STD18.DWG

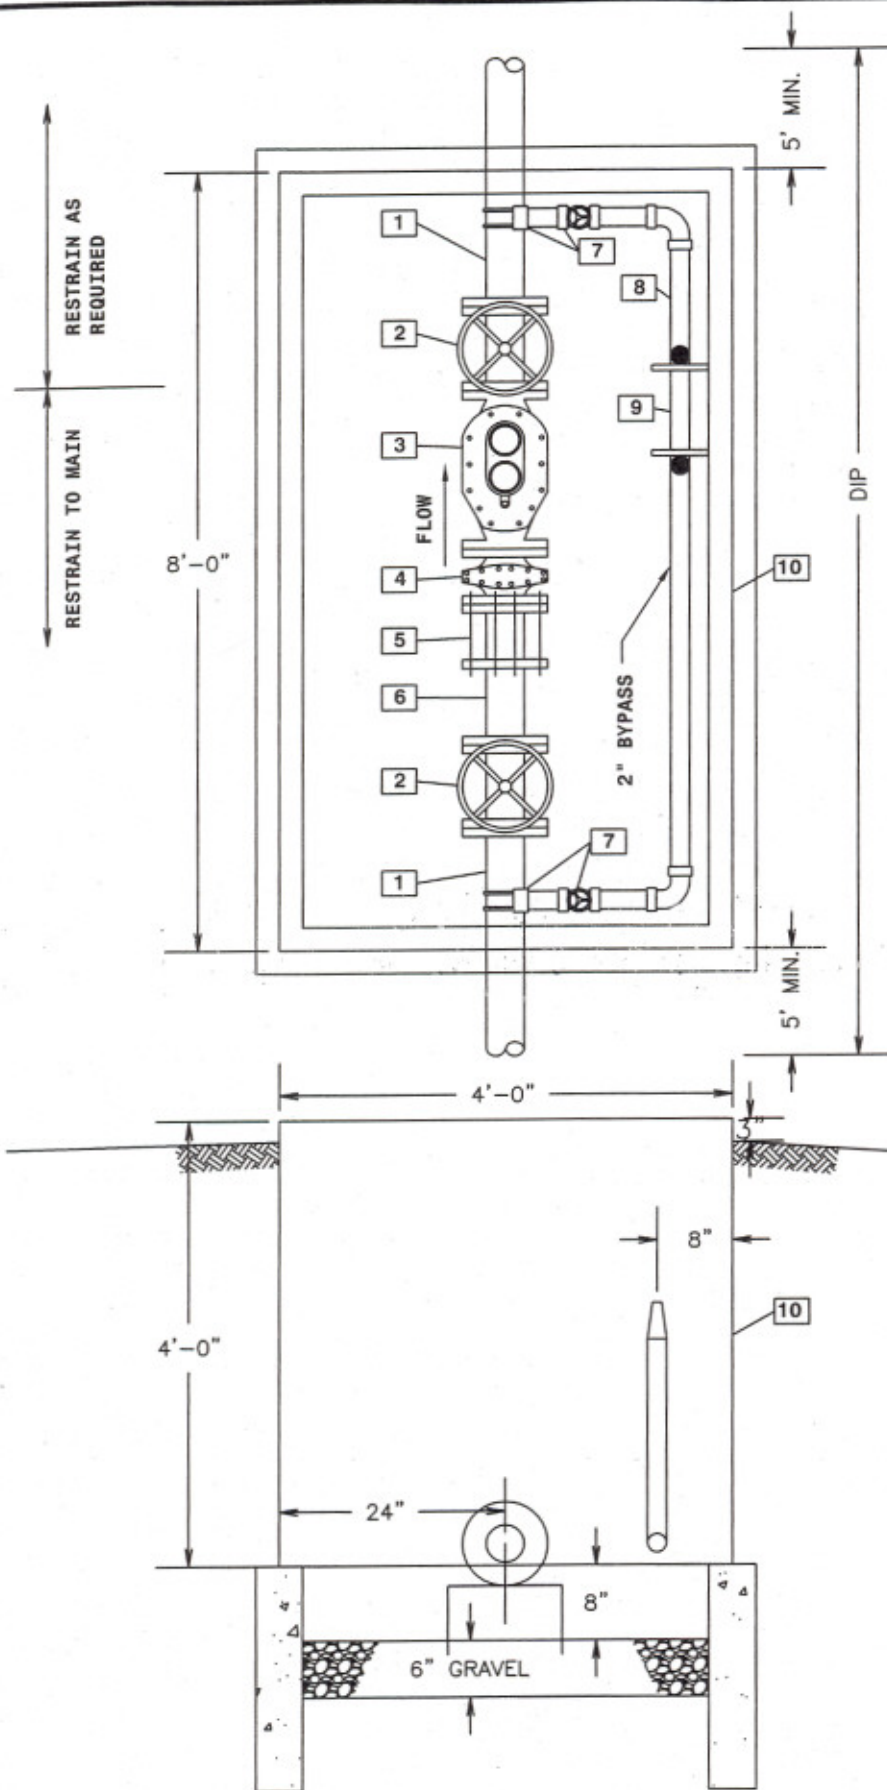

ITEM

- 1 4" FLG x PE CONNECTION PIECE
- 2 4" FLG GATE VALVE W/ HANDWHEEL
- 3 4" COMPOUND METER
(FURNISHED & INSTALLED BY SDCW)
- 4 4" FLG METER STRAINER
(FURNISHED & INSTALLED BY SDCW)
- 5 4" FLG COUPLING ADAPTER
- 6 4" FLG x PE CONNECTION PIECE
- 7 4" x 2" SERVICE SADDLE W/ 2"
BALL VALVE
- 8 2" TYPE K RIGID COPPER & FITTINGS
- 9 2" PREFABRICATED METER SETTER
(PER SDCW DETAIL)
- 10 4' x 8' PREFABRICATED VAULT W/
CONCRETE FOUNDATION
(PER SDCW DETAIL)

NOTES

1. CONTRACTOR SHALL USE SOLID CMU BLOCKING AND SHIMS AS PIPE SUPPORT NEAR CENTER OF PIPING RUN
2. CONTRACTOR SHALL LOCATE METER VAULT BEHIND CURB & GUTTER IN AREA THAT IS NOT SUBJECT TO VEHICULAR TRAFFIC.
3. CONTRACTOR SHALL SLOPE GRADE AWAY FROM THE VAULT.



SANGRE DE CRISTO WATER DIVISION
CITY OF SANTA FE, NEW MEXICO
STANDARD DETAILS



4" DOMESTIC SERVICE

DRAWN BY: BKS	DATE: 04/28/04
CHECKED:	SCALE: N/A
APPROVED:	U: /STANDARDS/STD19.DWG